

ATA AIRLINES, INC.

LAVATORY FIRE BOTTLE WEIGHT CHECK

PAGE 1 / 3

CHECK BEING PERFORMED: Custom

ZONES: 220 240
A/C NUMBER:
REV. DATE: 08/25/06
FREQUENCY: 2C

W/C NUMBER: 323I2603 DATE:

MFR P/N DESCRIPTION QTY
BAC5010TYPE60 Adhesive A/R

TOOLS DESCRIPTION QTY
DFM100 0 - 150 pounds scale, with hook and pad 1
COMMON Phenolic, Hard Resin Scraper (Commercially Available) 1

REFERENCES

Figure 1

MECH INSP

MPD Item: 26-290-00

1. Remove the Lavatory Fire Extinguishing Bottle as follows (Fig. 1).

- A. Open the waste compartment door.
B. Open the waste container door to get access to the fire extinguishing bottle [1].
C. Remove the waste container.
D. Remove the mounting screws [3] that hold the fire extinguishing bottle [1] in its position.

CAUTION: BE CAREFUL WHEN YOU REMOVE THE SEALANT. DO NOT SCRATCH THE PAINT AROUND THE NOZZLES. THIS CAN CAUSE DAMAGE TO THE AREA AROUND THE NOZZLES.

- E. Use a hard resin phenolic scraper and remove the sealant at the bottom of the nozzles [3].
F. Hold the fire extinguishing bottle [1] and carefully remove the nozzles through the holes in the seal.
G. Remove the fire extinguishing bottle [1].
H. The following signoffs pertain to steps 1. through 1.G.

XXXXX (1) Lav A fire extinguishing bottle.

XXXXX (2) Lav D fire extinguishing bottle.

XXXXX (3) Lav E fire extinguishing bottle.

A/C NUMBER:

CHECK BEING PERFORMED: Cust

W/C NUMBER: 323I2603 (continued)

MECH: INSP:

2. Use the gage, DFM100 and weigh the fire extinguishing bottle.

NOTE: The total weight of the halon and the bottle is shown on the label of the fire extinguishing bottle.

A. The fire extinguishing bottle must be replaced if the weight is not within 10 grams (0.022 pounds) of the weight shown on the fire extinguishing bottle.

B. The following signoffs pertain to steps 2. through 2.A.

_____ (1) Lav A fire extinguishing bottle.

_____ (2) Lav D fire extinguishing bottle.

_____ (3) Lav E fire extinguishing bottle.

3. Install the Lavatory Fire Extinguishing Bottle (Fig. 1).

A. Put the fire extinguishing bottle [1] in its position.

(1) Install the nozzles through the holes in the seal.

(2) Make sure the nozzles point into the waste container area.

B. Install the mounting screws [3] that hold the fire extinguishing bottle [1] in its position.

C. Apply the adhesive, BAC5010TYPE60 around the nozzles where they penetrate the waste compartment.

D. Install the waste container in the sink cabinet.

E. Close the waste container door.

F. Close the waste compartment door.

G. The following signoffs pertain to steps 3. through 3.F.

_____ XXXXX (1) Lav A.

LAVATORY FIRE BOTTLE WEIGHT CHECK

A/C NUMBER:

CHECK BEING PERFORMED: Cust

W/C NUMBER: 323I2603 (continued)


MECH: INSP:

_____ XXXXX (2) Lav D.


_____ XXXXX (3) Lav E.

***** END OF WORKCARD *****

32312603

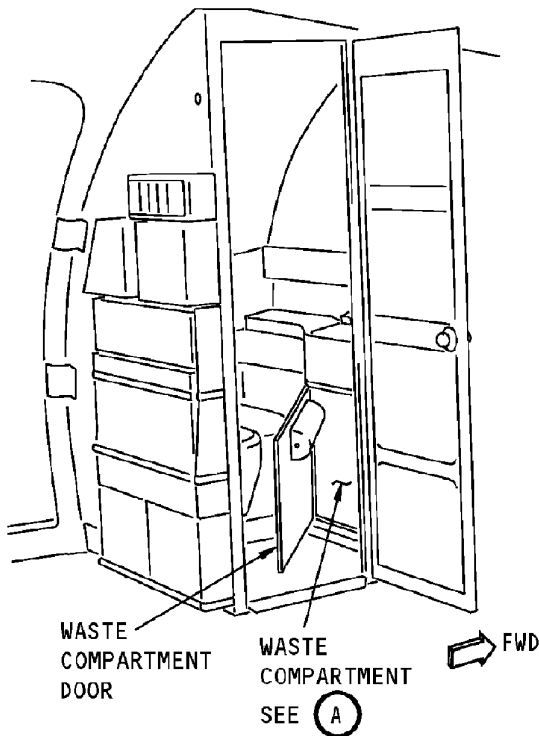


LAVATORY (EXAMPLE)

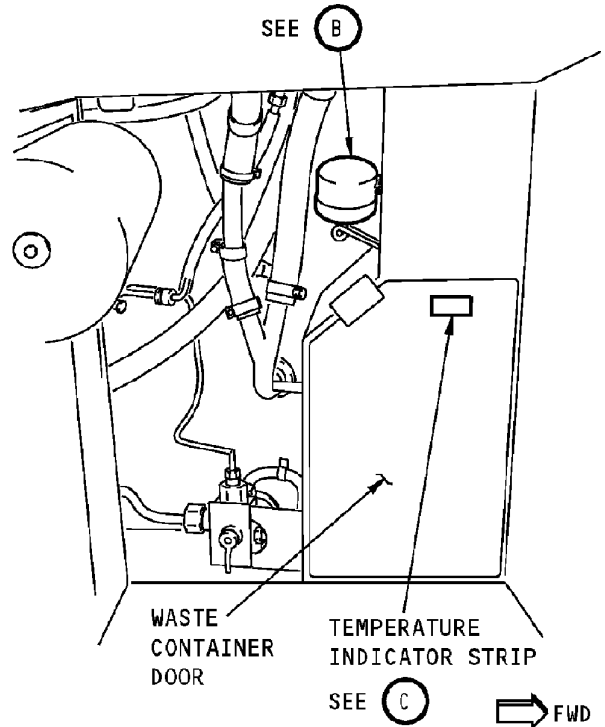


WASTE COMPARTMENT (WASTE CONTAINER NOT SHOWN)

(A)

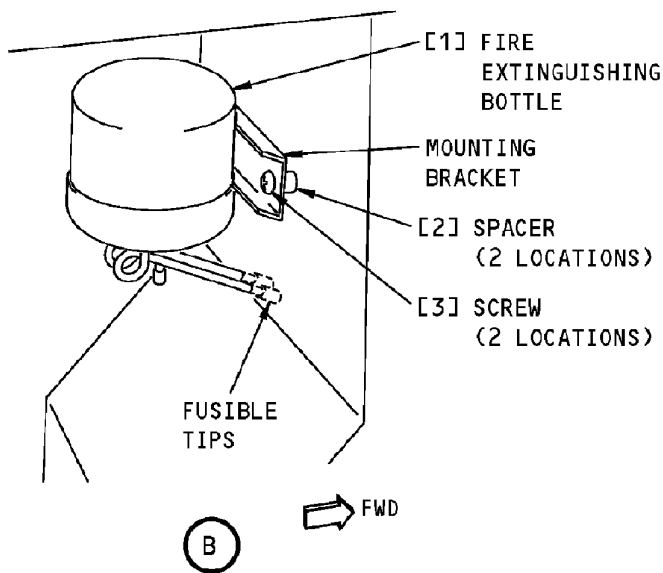

TEMPERATURE INDICATOR (BLACK WHEN EXPOSED TO TEMPERATURE GREATER THAN 180°F)

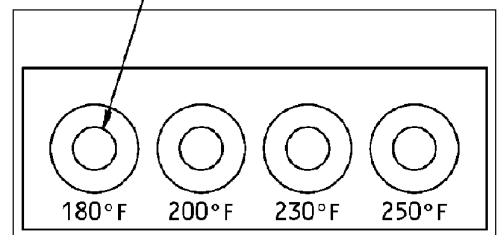

TEMPERATURE INDICATOR STRIP

(C)

Lavatory Waste Compartment Fire Extinguishing - Maintenance Practices Figure 1

LAVATORY FIRE BOTTLE DATE CHECK

08/28/2006